

:hager

6LE090765Ab - CO 155860

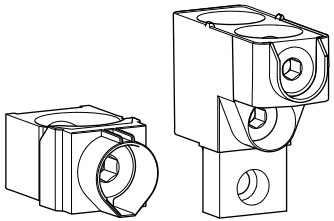

HYW001H 3P - HYW002H 4P
HYW007H 3P - HYW008H 4P


i

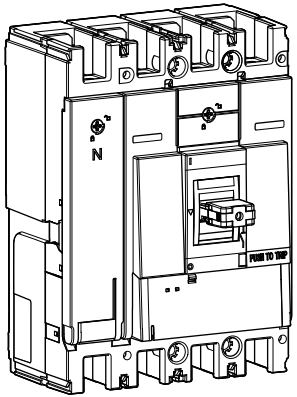

Maintenance is required when using aluminium wires. After the first power supply to check the connection area after 3 months, and re-tighten the terminals using the specified torque.


01

HYW001H 3P
HYW002H 4P




	Up to 630 A	
	min.	max.
	120 □	300 □

02

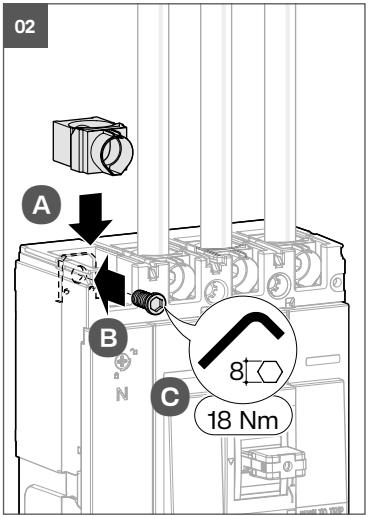


03

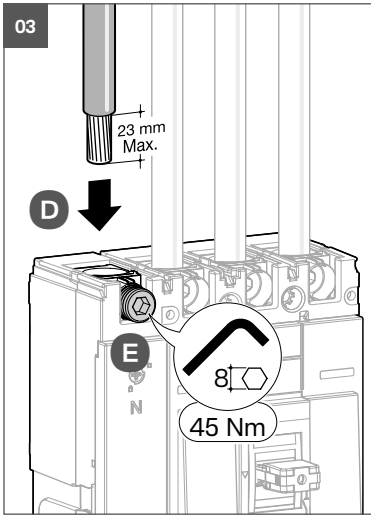

During the screw tightening, the cable should be held firmly to prevent it from moving out.


Hager Electro SAS, BP3, 67215 Obernai Cedex, France

HYW007H 3P
HYW008H 4P




	Up to 630 A	
	min.	max.
	120□	300□


01

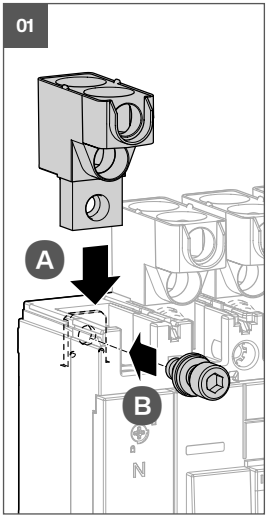

02

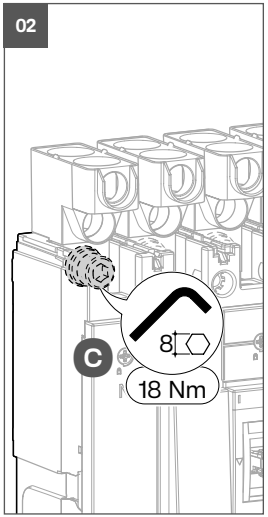

03

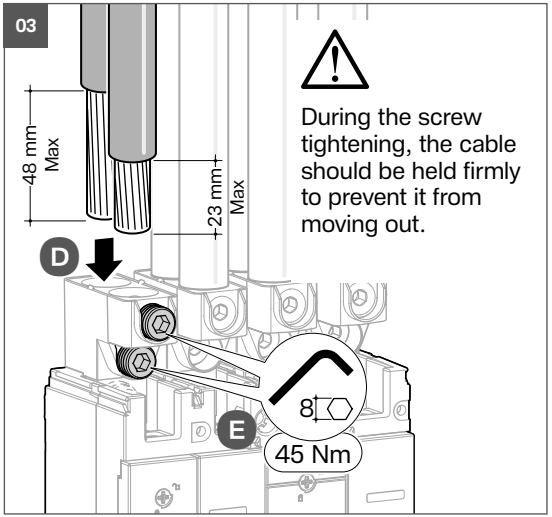

T +33 (0) 3 88 49 50 50 **F** +33 (0) 3 88 49 50 53 info@hager.com hager.com